


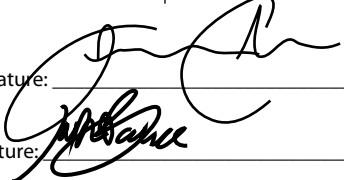


AAA Fire Safety & Alarm, Inc.
 334 North Marshall Way Suite G
 Layton, UT 84041
 Phone: 801-544-7345
 Fax: 801-544-1411
 www.aaafireutah.com

Clean Agent System Report of Test/Inspection

Company: CTU Date: November 1, 2011
 Address: 326 South State Street Technician: Joshua Clark
 City, State, Zip: Salt Lake City, Utah 84104 System Name: _____
 Contact Name: Jack Bauer Special Instructions: _____
 E-Mail: Jack@CTU.gov ****THIS IS AN EXAMPLE ONLY****
 Phone: 801-867-5309
 Fax: _____

Technician Signature: 
 Customer Signature: 

I state that the information on this form is correct at the time and place of my inspection, and that all equipment tested at this time was left in operational condition upon completion of this inspection except as noted.
 Except as noted, the building is occupied with the same occupancy classification and hazard of contents as last inspection. Also, the system has remained in service without modification and been free of actuation of devices or alarms.

Monthly Quarterly Semi-Annual Annual 5 Year Installation System Type: Halon

Panel Information

Manufacturer: Fike Model: 10-051 Serial #: 11111587523 Location: Basement Server Room
 Software Rev #: 2-5-96 Software Date: 2-5-96 Breaker/Fuse: Breaker Primary Disconnect Location: Basement Electrical/Panel G/Breaker #24
 Monitoring Acct #: 250042 Transmission Type: IP Monitoring Company: AAA Fire Safety & Alarm, Inc. Operator: Jenny

Devices (total quantity/tested):

Smoke Detectors: <u>3/3</u>	Horn/Strobes: <u>1/1</u>	Annunciators: _____	Other: _____
Heat Detectors: _____	Horns: _____	Waterflow Device: _____	Other: _____
Duct Detectors: _____	Strobes: _____	Supervisory Switch: _____	Other: _____
Pull Stations: <u>1/1</u>	Speaker/Strobes: _____	Elevator Relay: _____	Other: _____
Beam Detectors: _____	Speakers: _____	Door Holder: _____	Other: _____

Battery Tests (note additional battery tests on last page):

Location:	Manufacturer:	Date Replaced:	Condition:	Voltage w/Charger	Voltage:	Rated AH:	Tested AH:
Releasing Panel	Ultratech	2009	OK	27.9	13.9	7	6.2
Releasing Panel	Ultratech	2009	OK	27.9	13.8	7	6.0
Location:	Manufacturer:	Date Replaced:	Condition:	Voltage w/Charger	Voltage:	Rated AH:	Tested AH:
Location:	Manufacturer:	Date Replaced:	Condition:	Voltage w/Charger	Voltage:	Rated AH:	Tested AH:

Cylinders

Location:	Manufacturer:	Size:	Weight:	Pressure:	Pass?
Basement Server Room Mechanical	Ansul	25#	68	2800	Yes
Location:	Manufacturer:	Size:	Weight:	Pressure:	Pass?
Location:	Manufacturer:	Size:	Weight:	Pressure:	Pass?
Location:	Manufacturer:	Size:	Weight:	Pressure:	Pass?
Location:	Manufacturer:	Size:	Weight:	Pressure:	Pass?
Location:	Manufacturer:	Size:	Weight:	Pressure:	Pass?
Location:	Manufacturer:	Size:	Weight:	Pressure:	Pass?

All "No" answers are to be explained. - © AAA Fire Safety & Alarm, Inc. 2011-2012

